

RSIC ACOUSTIC ASSEMBLY

FLOOR CEILING ASSEMBLY


DIRECT FIX TO SOLID WOOD JOIST



Toll Free (866) 774-2100

WWW.PAC-INTL.COM

FCWT RAL IN09-011

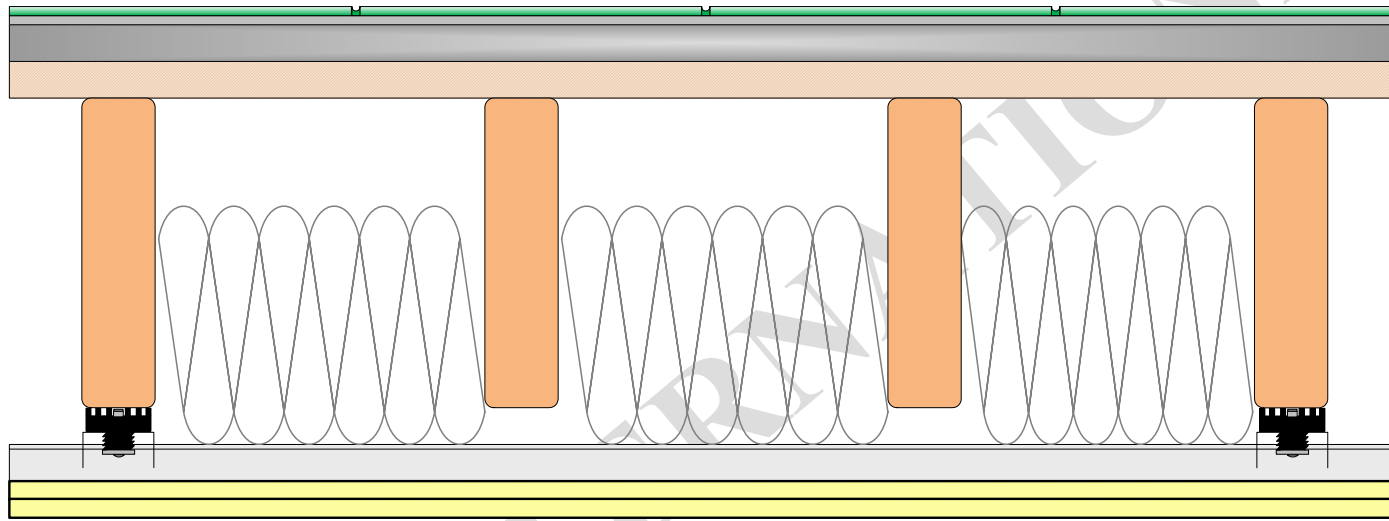

Fire Resistance Ratings

Designs:


L502, L514, L516, L523,
L532, L569, L590, L593

CONSTRUCTION

- CERAMIC TILE
- 1/4" TILE UNDERLAYMENT
- 3/4" LT WT CONCRETE
- 5/8" PLYWOOD SUBFLOOR
- 2" X 10" SOLID WOOD JOIST @ 16" OC
- R-19 FIBERGLASS BATT INSULATION (NOM 6")
- RSIC-1 INSTALLED @ 48" OC
- 7/8" DRYWALL FURRING CHANNEL @ 24" OC
- 2 LAYERS 5/8" FIRE CODE GYPSUM BOARD



RAL TL09-042
STC 55



RAL IN09-011
IIC 53

RIVERBANK ACOUSTICAL LABORATORIES (RAL)

TEST REPORT

FOR: PAC International, Inc.
7340 Smoke Ranch Rd., Suite A, Las Vegas, NV
89128-0261

Impact Sound Transmission Test
RAL™-IN09-011

ON: Test #2B – Ceramic Tile Section - RSIC-1 with Two
(2) Layers Gypsum Board with Lightweight Gypsum
Concrete

Page 1 of 5

CONDUCTED: 27 February 2009

TEST METHOD

The measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E492-04 and E989-06, as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure (NVLAP Lab Code: 100227-0). A description of the measuring technique is available separately.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the client as Test #2B – Ceramic Tile Section - RSIC-1 with two (2) layers gypsum board with lightweight gypsum concrete. The overall dimensions of the finished floor system were nominally 1.52 m (60 in.) wide by 1.52 m (60 in.) long. The overall dimensions of the substrate and ceiling system were nominally 4.27 m (14 ft) by 6.10 m (20 ft). The thickness of the finished floor system and substrate and ceiling system was 355 mm (14 in.) thick. The specimen was constructed directly in the laboratory's 4.27 m (14 ft) by 6.10 m (20 ft) test opening which was sealed on the periphery (both sides) with dense mastic.

The description of the specimen was as follows: From the top down, the floor consisted of ceramic tile floor, cement tile backerboard over 19 mm (0.75 in.) thick lightweight gypsum concrete over 19/32" span rated OSB board attached to 232 mm (9.125 in.) deep solid joist with a fiberglass insulated cavity, a double layer of 5/8" Firecode "C" gypsum board ceiling attached using Resilient Sound Isolation Clips (RSIC-1) and hat track. A more detailed description of the test assembly appears in the following sections.

Ceramic Tile Floor Section

The finished floor consisted of glazed ceramic tile. Each tile measured 305 mm (12 in.) wide by 305 mm (12 in.) long by 9.5 mm (0.375 in.) thick. The tiles were installed on 6.4 mm (0.25 in.) ceramic tile backerboard using a thinset mortar and grout and allowed to dry in excess of 7 days.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



TEST REPORT

PAC International, Inc.

RAL™-IN09-011

27 February 2009

Page 2 of 5

The total weight of the ceramic tile floor as calculated was 69.9 kg (154 lbs).

Lightweight Gypsum Concrete

The gypsum concrete was poured directly onto the plywood subfloor and allowed to cure in excess of 28 days. The gypsum concrete measured a nominal 19 mm (0.75 in.) thick and had an average density of 1,930 kg/m³ (120.5 pcf) calculated from poured samples. The total weight of the gypsum concrete floor as calculated was 956 kg (2,109 lbs).

Wood Subfloor and Support Assembly

The base floor consisted of 15 mm (19/32 in.) tongue and groove OSB board glued and nailed to two-by-ten (2 x 10) solid wood floor joists and box sill using 76 mm (3 in.) long 10d nails at 152 mm (6 in.) on center at the perimeter and 254 mm (10 in.) on 203 mm (8 in.) centers. The two-by-ten (2 x 10) solid wood joists horizontally spanned the width of the test opening and were attached to the sill plate with 10d nails. The joists were spaced on 406 mm (16 in.) centers, starting 203 mm (8 in.) either side of the centerline. Total weight of the subfloor and support assembly was 645 kg (1,421.25 lbs).

Insulation

The cavities between the joists contained a layer of 159 mm (6.25 in.) thick by 381 mm (15 in.) wide unfaced fiberglass batt insulation. The weight of the insulation was 28.1 kg (62 lbs).

Ceiling Assembly

The ceiling assembly consisted of 25 gauge roll-formed drywall furring channel (aka hat track) which measured 22 mm (0.875 in.) deep by 65 mm (2.56 in.) wide. Eight (8) full runs of drywall furring channel were mounted to the RSIC-1 clips, spaced at 24 in. by 48 in. center to center. Runs of drywall furring channels extending the full length of the test specimen included splices which were overlapped 152 mm (6 in.) and double wire tied with 18 gauge tie wire as necessary. Four runs of track 1.52 m (60 in.) long and four at 1.22 m (48 in.) long were installed parallel to the main runs as necessary to provide for independent suspension of each gypsum board at the butt joints. Total weight of the channels as measured was 22.2 kg (49 lbs). The hat track was attached to the PAC International's Resilient Sound Isolation Clips (RSIC-1), each fastened to the joists with a 63 mm (2.5 in.) long #8 coarse thread drywall screw. The RSIC-1 clips were

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

TEST REPORT

PAC International, Inc.

RAL™-IN09-011

27 February 2009

Page 3 of 5

installed to accommodate installation of the hat track perpendicular to the solid wood joists and spaced on 610 mm (24 in.) centers. For continuous run of hat track the RSIC-1 clips were installed on the joist on 1.22 m (48 in.) centers. For short independent sections of hat track the RSIC-1 clips were installed near each end. A total of 73 clips were used and weighed 4.6 kg (10.5 lbs). The ceiling consisted of a base layer of 16 mm (0.625 in.) thick, USG Firecode "C" gypsum board attached to the hat track with 25 mm (1 in.) Type S screws at 305 mm (12 in.) centers in the field and at 203 mm (8 in.) center at the butt joints and a face base layer of 16 mm (0.625 in.) thick, USG Firecode "C" gypsum board attached with 41 mm (1.625 in.) Type S screws at 305 mm (12 in.) centers in the field and at 203 mm (8 in.) center at the butt joints. The total weight of the gypsum board was 566 kg (1,249 lbs). Joints were treated with paper tape embedded in all-purpose joint compound and screw heads were covered with compound. Total weight of the ceiling assembly with insulation was 660 kg (1,454 lbs). The perimeter of the completed test assembly was sealed with dense mastic.

The weight of the entire specimen as calculated was 2,303 kg (5,076 lbs.), an average of 88.4 kg/m² (18.1 lbs/ft²). The area of the specimen was 26 m² (280 ft²). The source and receiving room temperatures at the time of the test were 24±1°C (75±1°F) and 53±2% relative humidity. The source and receive reverberation room volumes were 136 m³ (4,789 ft³) and 86 m³ (3,038 ft³), respectively.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



TEST REPORT

PAC International, Inc.

RAL™-IN09-011

27 February 2009

Page 4 of 5

TEST RESULTS

Sound pressure levels at 1/3 octave intervals, normalized to 10 square meters, are given in tabular form. The impact insulation class, IIC, was computed in accordance with ASTM E989-89 and ASTM E492-04.

<u>FREQ.</u>	<u>Ln</u>	<u>C.L.</u>	<u>DEV</u>	<u>FREQ.</u>	<u>Ln</u>	<u>C.L.</u>	<u>DEV</u>
100	64	1.06	5	800	60	0.31	5
125	59	1.40		1000	58	0.25	4
160	62	1.09	3	1250	53	0.25	2
200	61	0.67	2	1600	47	0.21	
250	59	0.46		2000	45	0.22	
315	58	0.50		2500	44	0.24	2
400	59	0.35	1	3150	37	0.29	
500	60	0.34	3	4000	28	0.46	
630	61	0.32	5	5000	21	0.45	

IIC=53

ABBREVIATION INDEX

FREQ. = FREQUENCY, HERTZ, (cps)

Ln = NORMALIZED IMPACT SOUND PRESSURE LEVEL, dB

C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT

DEV. = DEVIATION, dB > IIC CONTOUR (SUM OF DEV = 32)

IIC = IMPACT INSULATION CLASS

* = INDICATES A CORRECTION HAS BEEN APPLIED TO DATA
DUE TO BACKGROUND NOISE LEVELS

Tested by Marc Sciaky Approved by David L. Moyer
Marc Sciaky David L. Moyer
Experimentalist Laboratory Manager

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.




NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

TEST REPORT

**IMPACT SOUND TRANSMISSION REPORT
RAL - IN09-011**

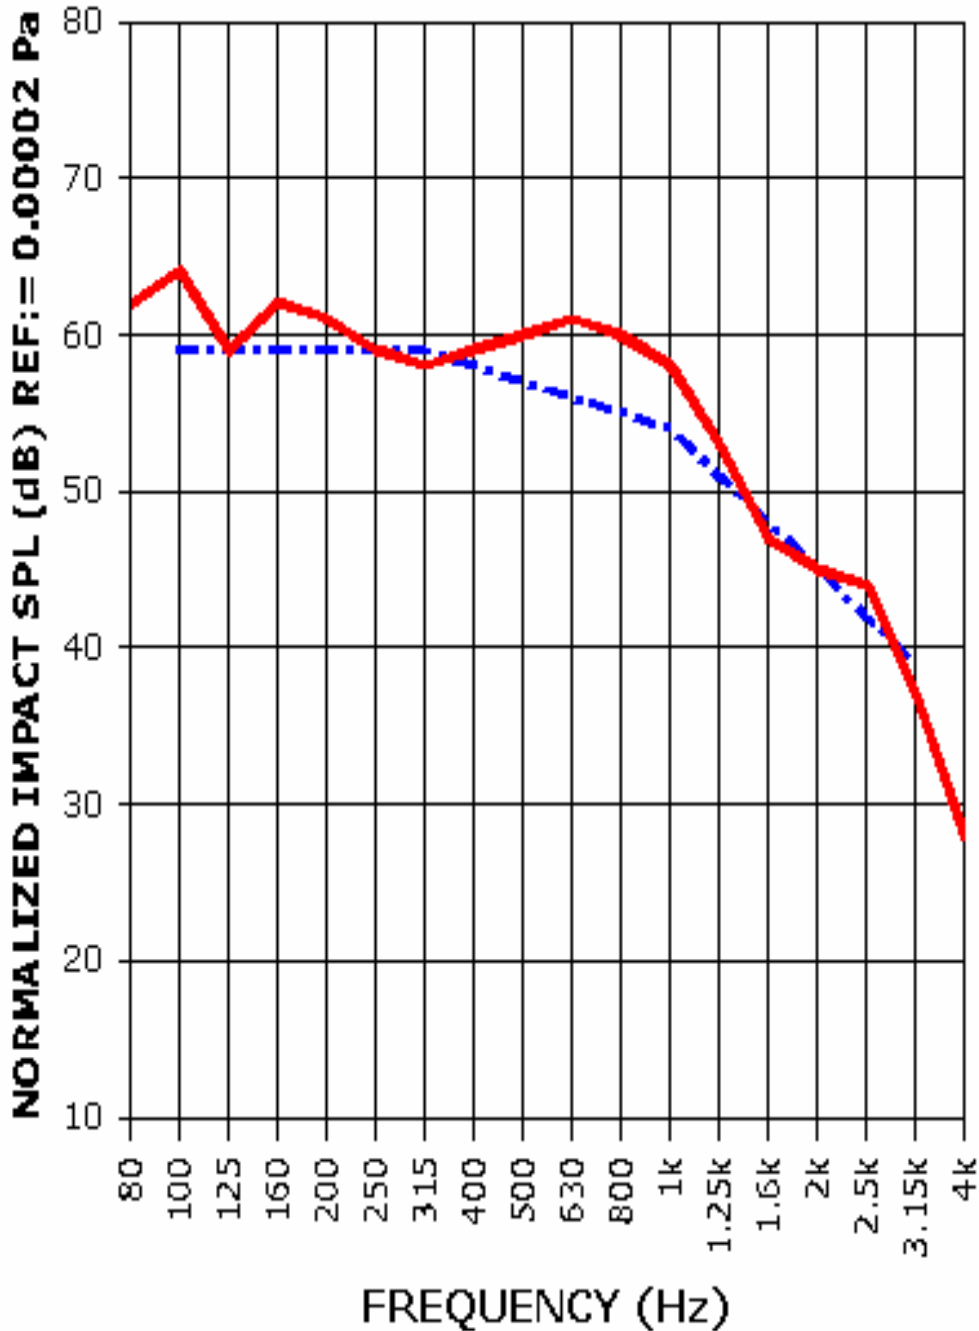

IIC= 53



IMPACT SOUND PRESSURE LEVEL
IMPACT INSULATION CLASS CONTOUR

This report shall not be reproduced except in full, without the written approval of RAL.
THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

RIVERBANK ACOUSTICAL LABORATORIES

1512 S. BATAVIA AVENUE
GENEVA, ILLINOIS 60134

Alion Science and Technology

630/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

TEST REPORT

FOR: PAC International, Inc.
7340 Smoke Ranch Rd., Suite A, Las Vegas, NV
89128-0261

Sound Transmission Loss Test
RAL™-TL09-042

ON: Test #2A – Sheet Vinyl - RSIC-1 Two (2) Layers
Gypsum Board with Lightweight Gypsum Concrete

Page 1 of 5

CONDUCTED: 27 February 2009

TEST METHOD

Unless otherwise designated, the measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E90-04 and E413-04, as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure (NVLAP Lab Code: 100227-0). A description of the measuring technique is available separately.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the client as Test #2A – Sheet Vinyl - RSIC-1 with two (2) layers gypsum board with lightweight gypsum concrete. The overall dimensions of the specimen as measured were nominally 4.27 m (168 in.) wide by 6.10 m (240 in.) high and 343 mm (13.5 in.) thick. The specimen was constructed directly in the laboratory's 4.27 m (14 ft) by 6.10 m (20 ft) test opening and was sealed on the periphery (both sides) with dense mastic.

The description of the specimen was as follows: From the top down, the floor consisted of sheet vinyl over 19 mm (0.75 in.) thick lightweight gypsum concrete over 19/32" span rated OSB board attached to 232 mm (9.125 in.) deep solid joist with a fiberglass insulated cavity, a double layer of 5/8" Firecode "C" gypsum board ceiling attached using Resilient Sound Isolation Clips (RSIC-1) and hat track. A more detailed description of the test assembly appears in the following sections.

Vinyl Floor

The floor covering sheet vinyl measured 3 mm (0.12 in.) thick. Total weight of the vinyl was 47.4 kg (104.5 lbs).

Lightweight Gypsum Concrete

The gypsum concrete was poured directly onto plywood subfloor allowed to cure in excess of 28

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

TEST REPORT

PAC International, Inc.

RAL™-TL09-042

27 February 2009

Page 2 of 5

days. The gypsum concrete measured a nominal 19 mm (0.75 in.) thick and had an average density of 1,930 kg/m³ (120.5 pcf) calculated from poured samples. The total weight of the gypsum concrete floor as calculated was 956 kg (2,109 lbs).

Wood Subfloor and Support Assembly

The base floor consisted of 15 mm (19/32 in.) tongue and groove OSB board glued and nailed to two-by-ten (2 x 10) solid wood floor joists and box sill using 76 mm (3 in.) long 10d nails at 152 mm (6 in.) on center at the perimeter and 254 mm (10 in.) on 203 mm (8 in.) centers. The two-by-ten (2 x 10) solid wood joists horizontally spanned the width of the test opening and were attached to the sill plate with 10d nails. The joists were spaced on 406 mm (16 in.) centers, starting 203 mm (8 in.) either side of the centerline. Total weight of the subfloor and support assembly was 645 kg (1,421.25 lbs).

Insulation

The cavities between the joists contained a layer of 159 mm (6.25 in.) thick by 381 mm (15 in.) wide unfaced fiberglass batt insulation. The weight of the insulation was 28.1 kg (62 lbs).

Ceiling Assembly

The ceiling assembly consisted of 25 gauge roll-formed drywall furring channel (aka hat track) which measured 22 mm (0.875 in.) deep by 65 mm (2.56 in.) wide. Eight (8) full runs of drywall furring channel were mounted to the RSIC-1 clips, spaced at 24 in. by 48 in. center to center. Runs of drywall furring channels extending the full length of the test specimen included splices which were overlapped 152 mm (6 in.) and double wire tied with 18 gauge tie wire as necessary. Four runs of track 1.52 m (60 in.) long and four at 1.22 m (48 in.) long were installed parallel to the main runs as necessary to provide for independent suspension of each gypsum board at the butt joints. Total weight of the channels as measured was 22.2 kg (49 lbs). The hat track was attached to the PAC International's Resilient Sound Isolation Clips (RSIC-1), each fastened to the joists with a 63 mm (2.5 in.) long #8 coarse thread drywall screw. The RSIC-1 clips were installed to accommodate installation of the hat track perpendicular to the solid wood joists and spaced on 610 mm (24 in.) centers. For continuous run of hat track the RSIC-1 clips were installed on the joist on 1.22 m (48 in.) centers. For short independent sections of hat track the RSIC-1 clips were installed near each end. A total of 73 clips were used and weighed 4.6 kg (10.5 lbs). The ceiling consisted of a base layer of 16 mm (0.625 in.) thick, USG Firecode "C"

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

TEST REPORT

PAC International, Inc.

RAL™-TL09-042

27 February 2009

Page 3 of 5

gypsum board attached to the hat track with 25 mm (1 in.) Type S screws at 305 mm (12 in.) centers in the field and at 203 mm (8 in.) center at the butt joints and a face base layer of 16 mm (0.625 in.) thick, USG Firecode "C" gypsum board attached with 41 mm (1.625 in.) Type S screws at 305 mm (12 in.) centers in the field and at 203 mm (8 in.) center at the butt joints. The total weight of the gypsum board was 566 kg (1,249 lbs). Joints were treated with paper tape embedded in all-purpose joint compound and screw heads were covered with compound. Total weight of the ceiling assembly with insulation was 660 kg (1,454 lbs). The perimeter of the completed test assembly was sealed with dense mastic.

The weight of the entire specimen as calculated was 2,280 kg (5,027 lbs.), an average of 87.9 kg/m² (18 lbs/ft²). The transmission area used in the calculations was 26 m² (280 ft²). The source and receiving room temperatures at the time of the test were 23°C (74°F) and 52±1% relative humidity. The source and receive reverberation room volumes were 136 m³ (4,789 ft³) and 86 m³ (3,038 ft³), respectively.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

TEST REPORT

PAC International, Inc.

RAL™-TL09-042

27 February 2009

Page 4 of 5

TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages. The precision of the TL test data is within the limits set by the ASTM Standard E90-04.

<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>	<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>
100	34	0.54		800	52	0.24	5
125	41	0.80		1000	54	0.12	4
160	38	0.60	4	1250	61	0.16	
200	42	0.54	3	1600	65	0.17	
250	45	0.42	3	2000	65	0.11	
315	49	0.51	2	2500	67	0.12	
400	51	0.40	3	3150	75	0.15	
500	53	0.29	2	4000	85	0.11	
630	53	0.37	3	5000	88	0.22	

STC=55

ABBREVIATION INDEX


FREQ. = FREQUENCY, HERTZ, (cps)
T.L. = TRANSMISSION LOSS, dB
C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT
DEF. = DEFICIENCIES, dB<STC CONTOUR (SUM OF DEF = 29)
STC = SOUND TRANSMISSION CLASS

Tested by Marc Sciaky Approved by David L. Moyer
Marc Sciaky David L. Moyer
Experimentalist Laboratory Manager


This report shall not be reproduced except in full, without the written approval of RAL.
THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

TEST REPORT

**SOUND TRANSMISSION REPORT
RAL - TL09-042**

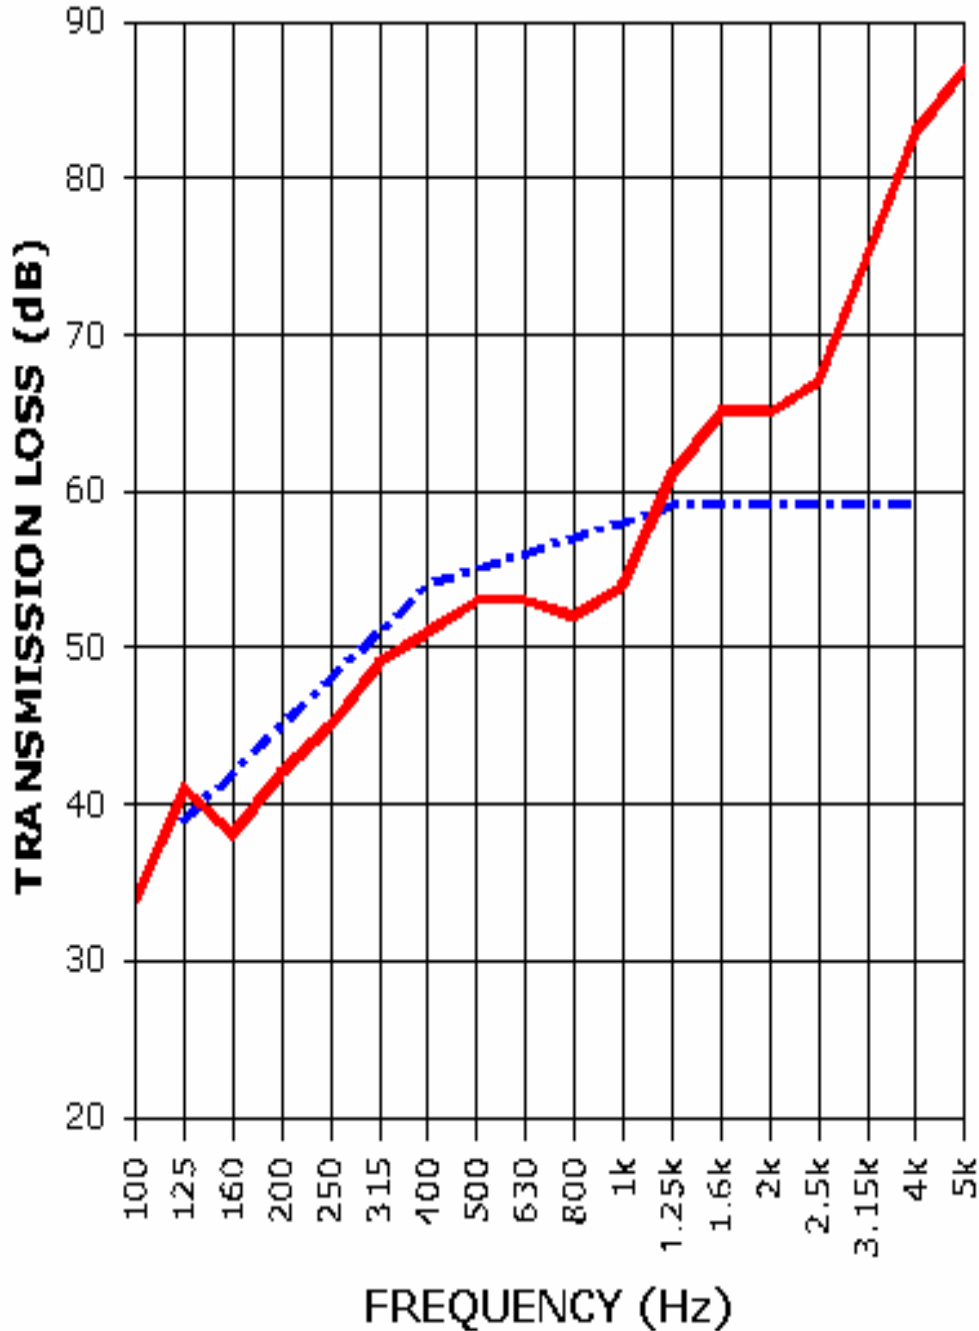

STC= 55



TRANSMISSION LOSS
SOUND TRANSMISSION LOSS CONTOUR

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.